


KA-5002 SCHEMATIC DIAGRAM

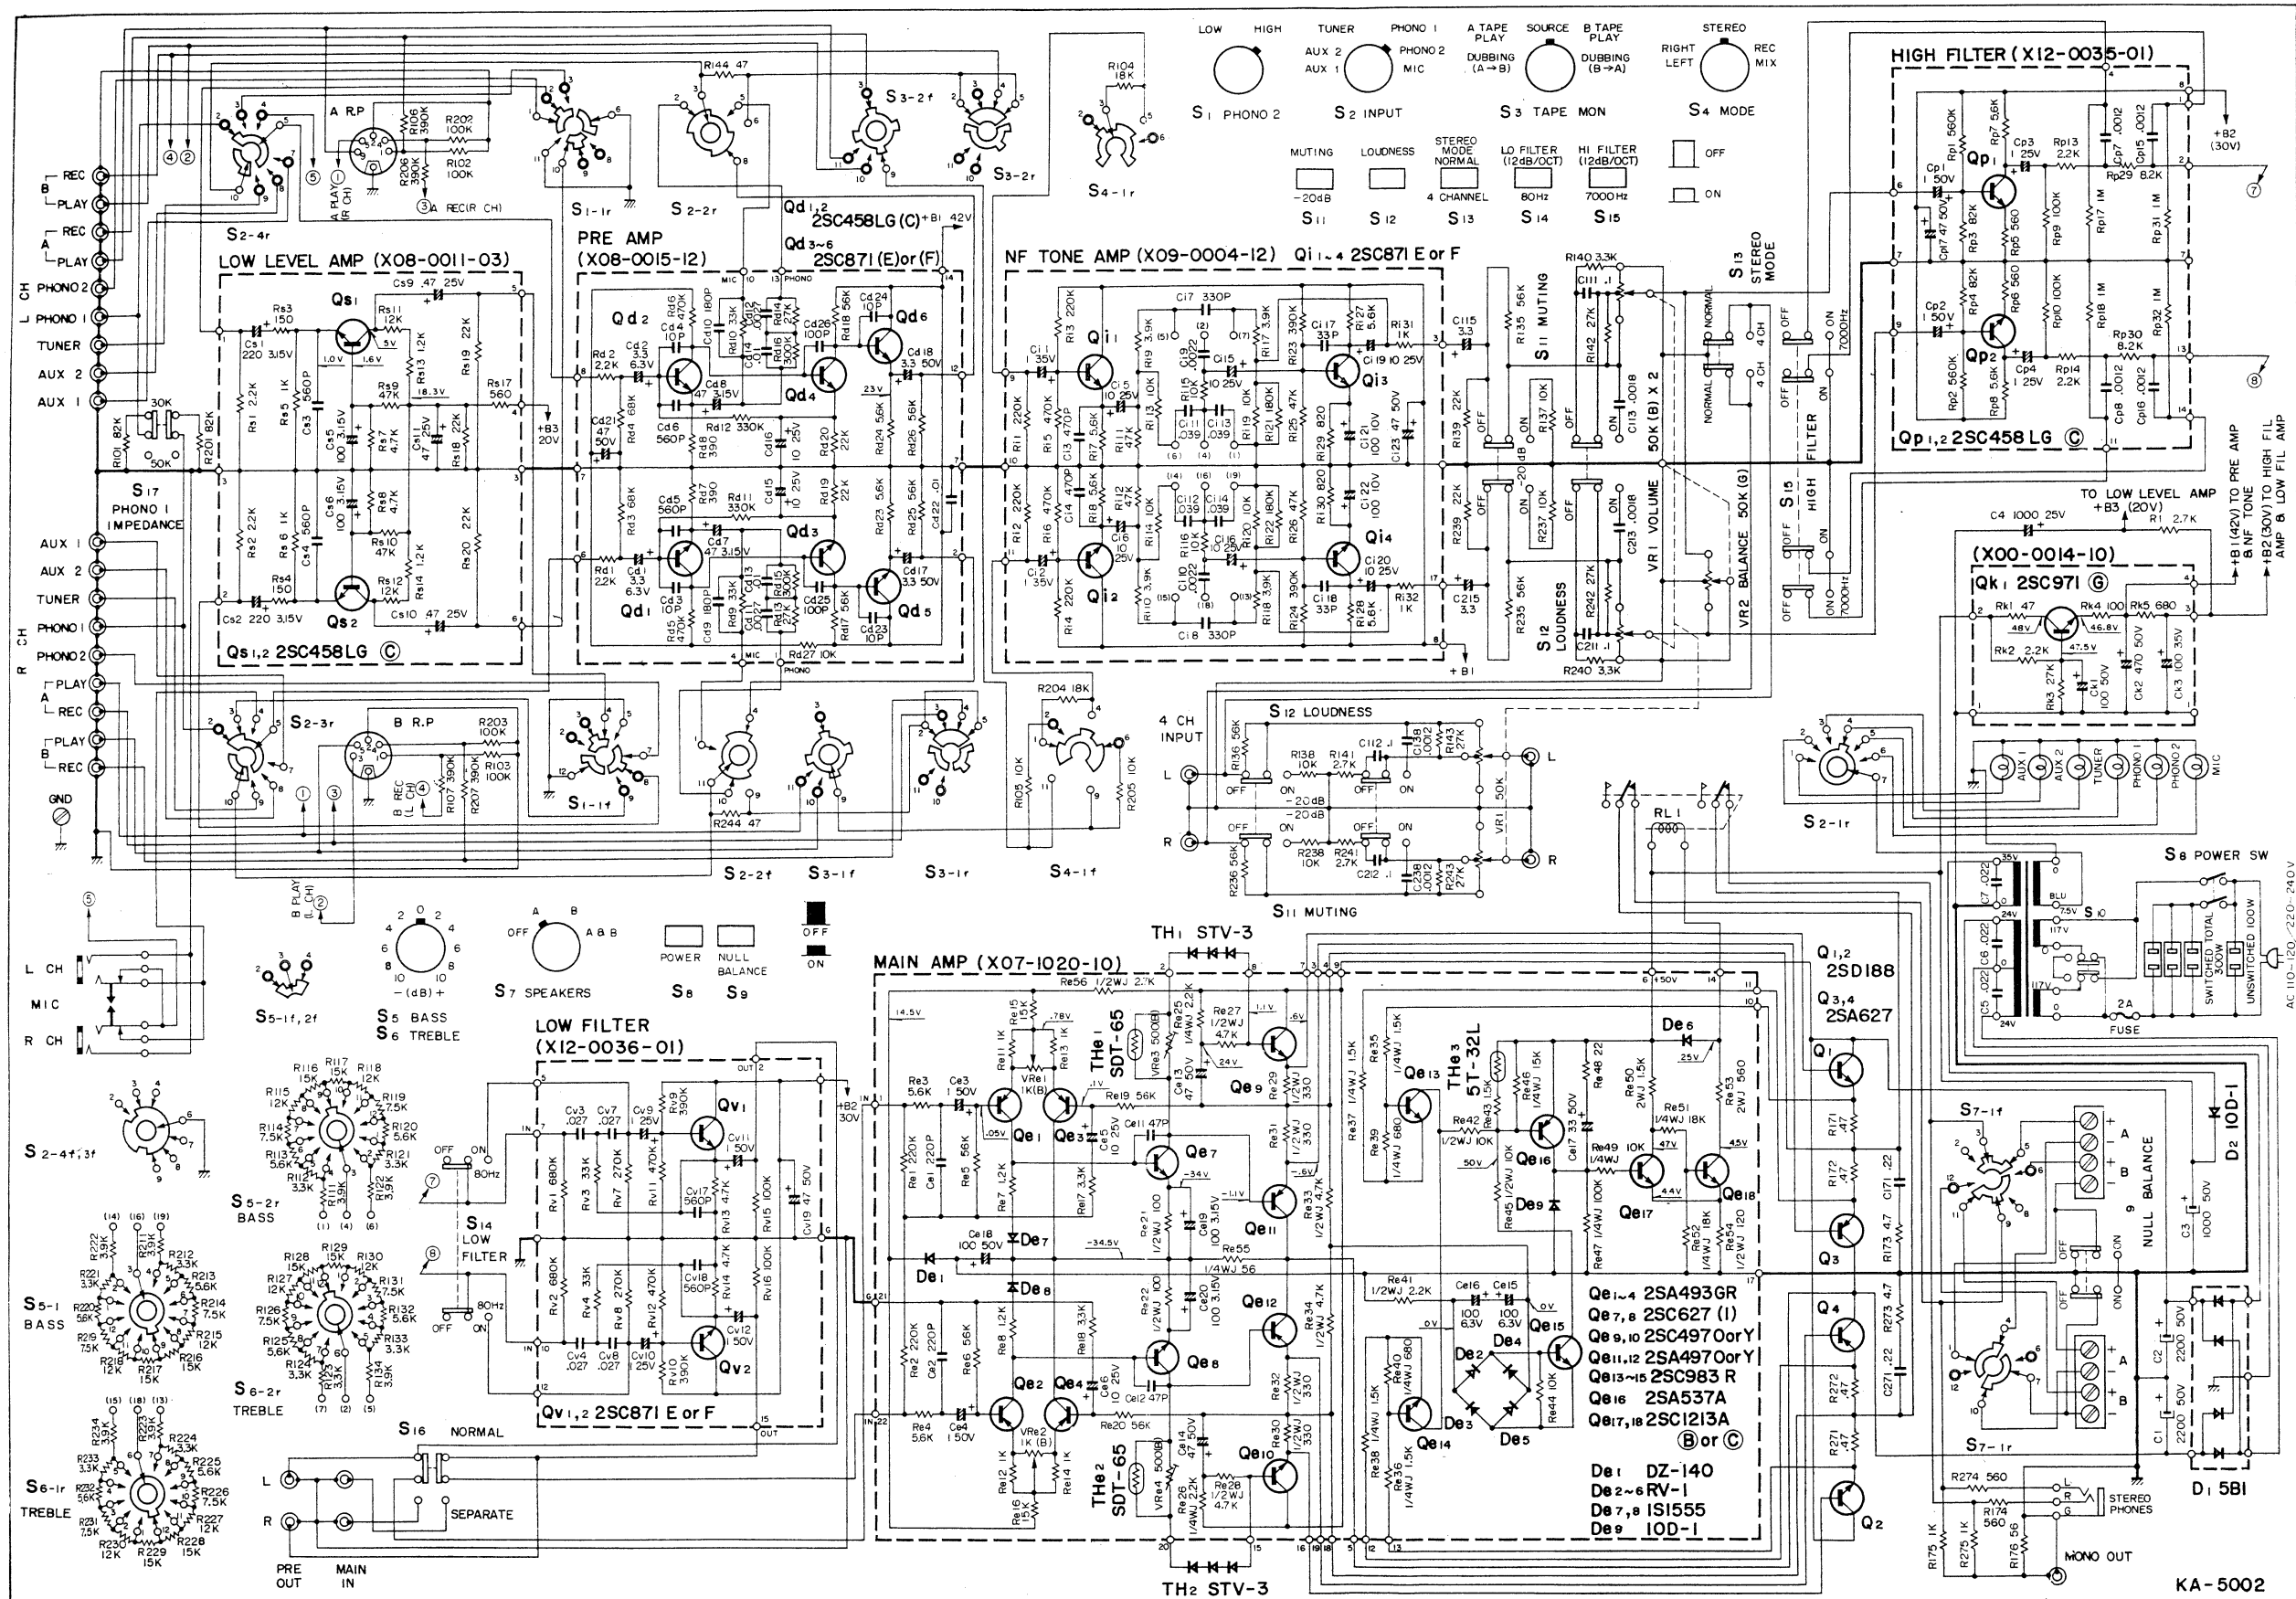

NOTE: For the sets sold in Europe except England, 1A fuses are placed in the power transformer 7.5V circuit and 35V circuit. Also, 2A line fuse is replaced with 1A fuse.

We reserve the right to make modifications in this model in accordance with technical developments.